

ORIGINAL RESEARCH

Inferring adversarial behaviour in cyber-physical power systems using a Bayesian attack graph approach

 Abhijeet Sahu  | Katherine Davis

Electrical and Computer Engineering, Texas A&M University, College Station, Texas, USA

Correspondence

 Abhijeet Sahu and Katherine Davis, Electrical and Computer Engineering, Texas A&M University, 4200 Boyett St, Apt D, College Station, TX, 77843 USA.
 Email: abhijeet_ntpc@tamu.edu and katedavis@tamu.edu

Funding information

U.S. Department of Energy, Grant/Award Number: DE-OE0000895

Abstract

Highly connected smart power systems are subject to increasing vulnerabilities and adversarial threats. Defenders need to proactively identify and defend new high-risk access paths of cyber intruders that target grid resilience. However, cyber-physical risk analysis and defense in power systems often requires making assumptions on adversary behaviour, and these assumptions can be wrong. Thus, this work examines the problem of inferring adversary behaviour in power systems to improve risk-based defense and detection. To achieve this, a Bayesian approach for inference of the Cyber-Adversarial Power System (Bayes-CAPS) is proposed that uses Bayesian networks (BNs) to define and solve the inference problem of adversarial movement in the grid infrastructure towards targets of physical impact. Specifically, BNs are used to compute conditional probabilities to queries, such as the probability of observing an event given a set of alerts. Bayes-CAPS builds initial Bayesian attack graphs for realistic power system cyber-physical models. These models are adaptable using collected data from the system under study. Then, Bayes-CAPS computes the posterior probabilities of the occurrence of a security breach event in power systems. Experiments are conducted that evaluate algorithms based on time complexity, accuracy and impact of evidence for different scales and densities of network. The performance is evaluated and compared for five realistic cyber-physical power system models of increasing size and complexities ranging from 8 to 300 substations based on computation and accuracy impacts.

KEYWORDS

cyber-physical systems, directed graphs, power system security, uncertainty handling

1 | INTRODUCTION

Power systems are cyber-physical critical infrastructure that need defense against a wide range of threats involving various adversary motivations, capabilities and tactics. Hence, it is indispensable to prioritize grid resilience to cyber threats. The need is evidenced from major historical events, for example, Stuxnet in 2008 [1], Ukraine in 2015 [2] and an intrusion into the European Network of Transmission System Operators for Electricity (ENTSO-E) in 2020 with potential to compromise 42 transmission system operators across 35 member states in Europe [3].

The behavioural characteristics of threat actors are important to study to assess the potential of early events to

propagate to physical impact. How threats can propagate through adversarial movement in a network with vulnerability exploitation and privilege escalation is crucial knowledge for stakeholders. The way to obtain such knowledge is a cyber-security risk assessment [4]. Risk assessments are often assisted by attack trees or attack graphs, a type of graph formalism for analysing network and host vulnerabilities in terms of access paths to compromise a target [5]. An attack graph captures the relationships among various vulnerability exploits that could be incorporated by the intruder, along with the privileges escalated, to compromise a single or a set of targets.

Despite the importance and the need, major challenges exist in inferring the point of intrusion and compromised

This is an open access article under the terms of the Creative Commons Attribution License, which permits use, distribution and reproduction in any medium, provided the original work is properly cited.

© 2023 The Authors. *IET Cyber-Physical Systems: Theory & Applications* published by John Wiley & Sons Ltd on behalf of The Institution of Engineering and Technology.

elements. While intrusion detection systems (IDSs), system logs and various cyber and physical side features contain evidence, the evidence only observes symptoms of an event and must be interpreted. Two types of uncertainty contribute to this challenge, that is, *aleatory*, caused by random behaviour of systems, and *epistemic*, caused by the lack of complete knowledge of the system. Three types of methods from probability theory are relevant to address both types of uncertainty in intrusion analysis: a) Monte-Carlo, b) Bayesian and c) Dempster-Shafer theory [6]. Among these, Bayesian Networks (BNs) are adopted in this work for four major reasons:

1. The BN formalism is versatile and allows ease of construction from many sources, for example, cybersecurity domain experts' prior knowledge, different threat models and by learning from raw data. By comparison, the *Inter-Domain Evidence theoretic Approach for Inference (IDEA-I)* based on Dempster Shafer Theory of Evidence (DSTE) [7] is shown to assist in reducing false alarms, but has challenges with incorporating domain knowledge, high computational expense and inability to capture causal relationships between events. Compared to DSTE, BNs are advantageous for incorporating prior model information in the defense of power systems.
2. BNs are probabilistic graphical models (PGMs) that help account for uncertainty of an adversary's behaviour. For instance, in the 2015 Ukraine attack, after the intruder obtained remote access to the operational technology (OT) network, it focused on a malicious firmware update to deploy in the HMI [2], while in the Colonial Pipeline attack of 2021, after a threat affiliate obtained remote access by exploiting a vulnerability (CVE-2021-20016) in SonicWall SMA100 SSL VPN, it planted a backdoor, SmokedHam, and issued a press release of the compromised state of the firm in NASDAQ and demanded ransom [8], which conveys that *from a same security state, an adversary can adopt different trajectory*.
3. The BN formalism is capable of performing the important function of causal reasoning between each step in the access paths of the adversary's trajectory to compromise the target.
4. For decision-making problems, Bayesian Reinforcement Learning (BRL) is being extensively studied [9] and relies upon the accuracy of the inferences, further motivating the study of BNs for their safety and accuracy within a critical infrastructure environment.

Using BN, two related problems can be formulated and addressed: (a) Bayesian inference, and (b) Bayesian structure learning. This work extends [10] that considered the Bayesian structure learning problem to learn the structure of the attack graph, given the raw data, with constraint-based and score-based techniques. By comparison, this work focuses on Bayesian inference, with application to detection as well as response under uncertainty using BRL. Hence, a '*Bayesian approach for inference of the Cyber-Adversarial Power System*' (*Bayes-CAPS*) is presented that leverages the BN formalism for constructing and inferring the Bayesian attack

graphs (BAGs) in power systems. Performing Bayesian inference on these graphs enables Bayes-CAPS to compute the likelihood that a host in the network is compromised or not given a set of alerts [11] and maps exactly to the detailed power system cyber-physical topology. The major contributions are as follows:

1. The OT threat scenario is considered in high fidelity, which differs from IT, with OT and IT prioritizing low latency and throughput, respectively. Similarly, peer-to-peer communication is rarely observed in OT but supported in the Internet. An IEC 61850 *Type 1A/P1* message for fault isolation and protection has a delay constraint of 3 ms, while for a less time-critical *Type 3* message, it is 500 ms [12]. Hence, generation of Bayesian attack graphs in a cyber-physical power system is a mixture of different types of networks and a contribution of this work.
2. The five case studies used to generate BAGs in Bayes-CAPS are constructed based on detailed realistic data flow models that capture the NERC-CIP-005 standards on electronic security perimeters for bulk energy systems.
3. From the communication networks, Bayes-CAPS contributes a method to construct BAGs using the power system threat and data-flow models [13].
4. Bayes-CAPS assesses how different evidence sources impact inference. Results with respect to varying threat strength, and on the basis of scale, accuracy, computation time, dependence on evidence and loops are detailed for five power system use cases. This is crucial to the accuracy of Partially Observable Markov Decision Processes (POMDP) for estimating cyber-physical state in power systems, since the Bayes-CAPS inference would update its belief state. The POMDP's belief state is crucial to reinforcement learning (RL) and hence its potential to be safely used in power system critical infrastructures.
5. The work integrates the Bayesian inference and structure learning framework into the Resilient Energy Systems Lab (RESLab) testbed as a plugin named Bayes-CAPS.

The paper proceeds as follows. Section 2 positions Bayes-CAPS with respect to related work. The Bayes-CAPS framework is presented in Section 3. Section 4 presents the BAG generation step. Section 5 details the five cyber-physical power system use cases. Section 6 presents the inference step and impact analysis of evidence. Section 7 provides the Bayes-CAPS pseudocode. Section 8 evaluates Bayes-CAPS and Section 9 concludes the paper.

2 | POWER SYSTEM SECURITY INFERENCE BACKGROUND

A significant amount of background is relevant, as this work stems from several distinct areas; detailed coverage is beyond the scope of this paper. Hence, the focus in this section is on background aspects that are most relevant and critical to positioning this work, categorized into key aspects that enabled

us to attain this new solution and can enable others to understand, repeat and extend this work.

2.1 | The problem of power system critical infrastructure cyber-physical security inference

A power system as a graph has cyber, physical and cyber-physical interconnected nodes. Intrusions may propagate within the cyber portion of the network, to sequentially exploit vulnerabilities and escalate privileges over cyber nodes, finally targeting the interconnecting nodes, to affect physical devices such as breakers. The propagation is uncertain from both intruder and defender perspectives. An intruder can follow any strategy depending on its successful tactics, while a defender can only observe symptoms such as resulting network latency or contingencies.

This motivates Bayes-CAPS to use PGMs. A specific PGM variant called a Bayesian Network (BN) is considered for modelling threats using inference on attack graphs. Conventionally, for intrusion analysis, a dedicated Security Information and Event Management is deployed to combine and show security information, and it is isolated from an Energy Management System (EMS). By comparison, a cyber-physical EMS is a new type of EMS currently being developed by researchers with industry partners [14], which includes an early-stage attack detection and response capability based on cyber and power information. For the research and development of this capability, a cyber-physical large-scale power system testbed, RESLab, has been built and continues to be expanded to simulate complex threat and defense scenarios, build theoretical models [15], infer intrusions and respond optimally. RESLab supports generation and emulation of power models and their communication networks [16] and allows ICS traffic such as MODBUS, DNP3, etc., to flow realistically through the network. In multi-stage cyber intrusions, there is a causal relationship between the events in the stages [17]. Hence, Bayes-CAPS develops and adopts BAGs in the cyber-physical power system setting to perform causal reasoning between each step in access paths towards an adversary's physical target.

2.2 | BNs in security

BNs are well-known for modelling decision problems under uncertainty. In network security, BNs have been proposed for over a decade. The first work on modelling attack graphs through BNs was published in 2008 [18]. BNs have also been suggested in IDSs, such as [19] that builds an adaptive IDS for attack signature recognition and [20] that proposes an intrusion intention recognition system. Despite work on BNs for network security, recognizing adversary intention and strategy has remained challenging due to numerous uncertainties in an IT network. By contrast, OT power networks have more static architectures and prior knowledge can be applied to lessen the uncertainty and make BNs a useful tool.

2.3 | BNs in power systems

In power systems, a main use of BNs is to perform model-based diagnostics. In Ref. [21], authors propose a probabilistic-based approach, where the electric power system is represented as a BN in the testbed at the NASA Ames Research Center. The idea of an inference-based expert system is proposed in Ref. [22] to support control centre decision-making under emergency. Similarly, a recent work on equipment failure estimation of power distribution system equipment, such as on-load tap changers and switched capacitors, using Bayesian inference, is presented in Ref. [23].

The use of PGMs for combined cyber-physical security analysis is less explored. Authors in Ref. [19] provide a framework for an adaptive IDS that uses BNs, and Ref. [24] performs an exact inferencing algorithm using junction tree and Belief Propagation (BP). An anomaly reasoning engine is proposed in Ref. [25] that utilizes Bayesian inference on causal polytrees to produce a high-level view of the security state in a supervisory control and data acquisition (SCADA) network. The work in Bayes-CAPS is motivated by Refs. [24, 25] to propose Bayesian inference algorithms for networks of realistic size and complexity, and to recommend viable inference solutions for these networks using dynamic evidences.

2.4 | Automatic attack graph generation

Numerous works address automatic attack graph generation. Researchers in Ref. [26] propose novel approaches for generating attack privilege fields as prerequisites and post-conditions based on the Common Vulnerability Scoring System (CVSS) and the National Vulnerability Database (NVD). The NVD and CVSS are widely used and detailed in Ref. [27]. Authors in Ref. [28] propose an approach to construct knowledge graphs from structured data, while Ref. [29] proposes an algorithm that optimizes the network topology before generating the graph. Instead of using CVSS scores to approximate attack characteristics, our work constructs the initial BAG parameters based on the CVSS score distribution.

2.5 | Bayesian inference algorithms

Bayesian inference is used to calculate the posterior probability of query variables, given a set of evidences. In Ref. [30], authors propose an improved likelihood weighting algorithm to extrapolate network security states using attack graphs and intrusion evidence. Authors in Ref. [18] propose to model probability metrics based on a special BAG using conditional probabilities to model interdependencies between vulnerabilities. A graphical inference engine for multiple-intrusion detection is proposed in Ref. [17] that performs BP on an appropriately constructed weighted bipartite graph. Variable Elimination (VE) is used in Ref. [31] to improve the accuracy and efficiency of a dynamic BN to infer intention and behavior

in human-robot interaction. Authors in Ref. [32] propose an intrusion detection and prevention system for zero-day attacks using Bayesian structural and parametric learning. Junction tree-based Bayesian inference is adopted in Ref. [33] to trace the most probable access paths from all possible atomic paths. In our work, we adopt BP using Factor Graphs (*BP_FG*) [34], VE [35], Pearl's Belief Propagation (*PBP*) [36] and Junction Trees (*JT*) [37].

2.6 | Context of Bayes-CAPS

By comparison, this work details a Bayesian framework for defining and solving the inference problem of adversarial behaviour, based on realistic power system electric and cyber model information, using cyber-physical attack graph analysis and Bayesian networks, as a way to better understand adversarial movement towards a physical target in these systems. The applicability to the real-world power systems is a major benefit of Bayes-CAPS as opposed to other methods with a similar objective. Of particular note is the ability to incorporate known system information, which is a key benefit and highly advantageous to grid defense.

For crucial power system computation and control environments, Bayes-CAPS is versatile and allows ease of construction from cybersecurity domain experts' prior knowledge, threat models and learning from raw data. Further, BNs are PGMs that help account for uncertainty of an adversary's behaviour, which is a serious and major issue in power systems, and this work is an important contribution towards addressing that need. The approach is capable of performing the important and currently lacking function of causal reasoning between each step in the access paths of the adversary's trajectory to compromise the target.

Power system cyber-physical critical infrastructure systems are considered in high fidelity, with threats targeting OT and grid operational reliability. Critical infrastructure systems are distinct based on the essential nature of the societal functions they protect. In cyber-physical critical infrastructure, availability and integrity are of utmost importance. Integrity, availability and timeliness are crucial; power systems must remain online. Timely delivery of accurate commands and measurements must always occur, even under extreme scenarios. Presenting and demonstrating Bayes-CAPS for five realistic power system cyber-physical case studies is a contribution of this work to advance critical infrastructure defense. Bayes-CAPS shows how BAGs can be automatically constructed and applied based on detailed realistic data flow models that real utilities will be using based on NERC CIP standards for bulk energy systems. Hence, this work will help achieve deployability and applicability in real world power systems. To further aid deployability in utilities, it is important to understand how to place and configure the monitoring tools (e.g., budget may be limited, monitoring must be prioritized based on risk and observability). Hence, the experiments and test cases in this work can also lend guidance on how the most useful evidence may be collected.

3 | BAYESIAN FRAMEWORK IN CYPRES EMS

The Cyber-Physical Resilient Energy Systems (CYPRES) EMS [14] is a prototype cyber-physical EMS being developed and evaluated in RESLab [38]. The work in Bayes-CAPS is implemented in the CYPRES EMS and leverages the *pgmpy* package [39] for inference algorithms such as VE, BP and Infer.NET [40], as shown in the left side of the tool (Figure 1). The inference and learning engines in CYPRES are running as python scripts. This work integrates these libraries in the CYPRES EMS to (1) provide core functionality for causal inference and (2) to provide a framework for performing inferences for various cyber-physical power system use cases.

The inference engine is at the utility control centre and at the substation level in the hierarchy (see Figure 4). In Figure 1, the sub-graph of the utility control center network is selected, then the inference type and node are selected. The screenshot of the tool shows a sample of the analysis and results described in this paper. Specifically, the tool shows the conditional probability table (CPT) associated with the selected firewall, that is, *Utility 39.Firewall 1368* in the model. The scores show the conditional probability of the host being compromised if the selected firewall is compromised. The right side of the tool shows the learned structure of the BN, given raw alerts in the form of the Pandas dataframe. In the current tool, the graph-based structure learning algorithms are incorporated based on Ref. [10].

4 | BAYESIAN ATTACK GRAPH MODEL GENERATION

Cyber-induced threats often initiate from the cyber layer of a cyber-physical network, as witnessed in events such as Stuxnet, Ukraine and Colonial Pipeline attacks. Hence, for studying intruder propagation to reach its target, it is essential to model the communication network for each physical system in detail.

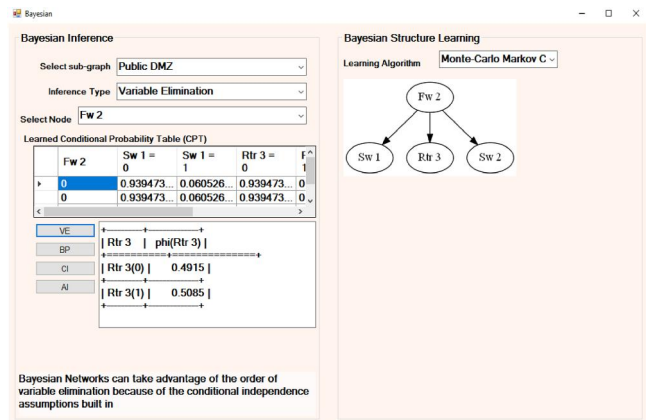


FIGURE 1 Screenshot of Bayes-CAPS tool for Bayesian inference and learning in the CYPRES Energy Management System (EMS) prototype to infer adversary behaviour in a cyber-physical power system.

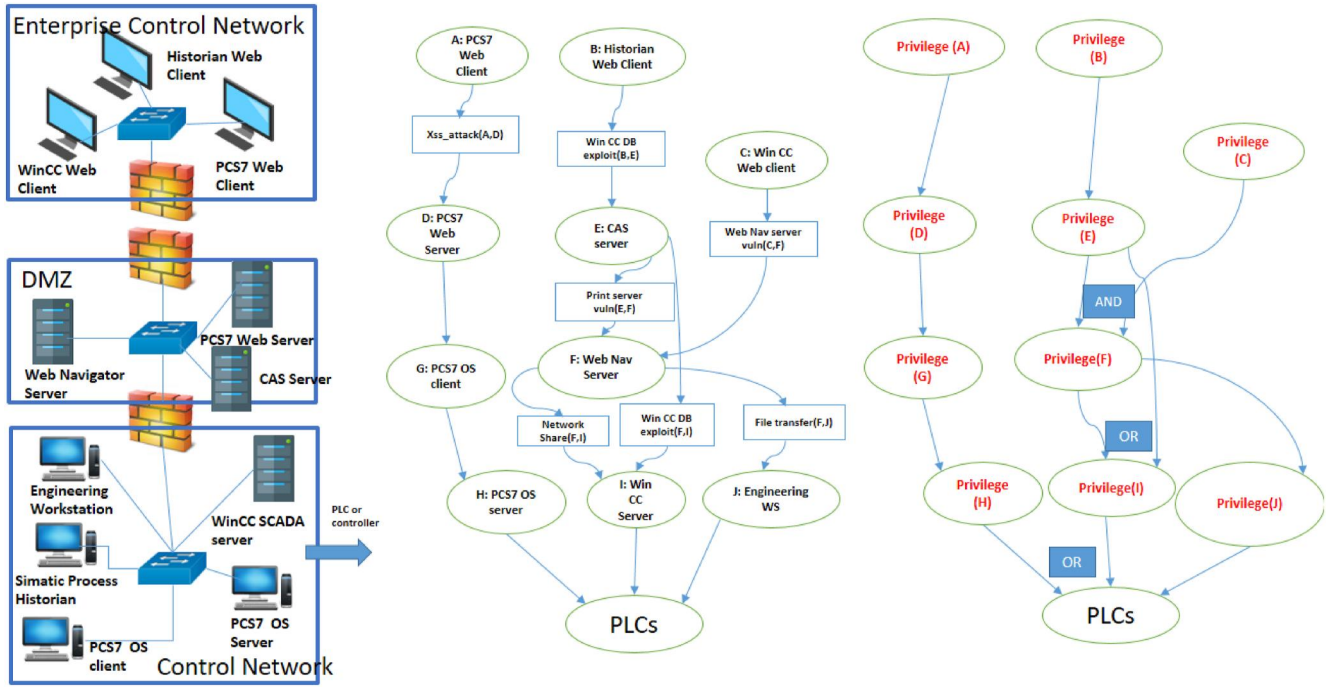


FIGURE 2 Bayesian Attack Graph (BAG) modelling example: An industrial control system (ICS) supervisory control and data acquisition (SCADA) network (left) is converted to a logical attack graph model (centre, Section 4.1), then to a BAG using a Bayesian network (BN) (right, Section 4.2).

Hence, this work first constructs the communication network for the power systems under study, following the approach for the synthetic communication network built for a 2000-bus electric grid model [16]. Further, this work interfaces the network models with the power systems and constructs a Bayesian variant of attack graphs for cyber-physical systems. In the revision, Sections 2, 5 and 9 are updated accordingly, (1) to enhance reproducibility now by clarifying details about the datasets and models available now, and (2) to explain the next steps in the direction to open-source additional code and data.

An attack graph is a graphical model that represents how the vulnerabilities in a network can be sequentially or parallelly exploited, showing different paths an adversary can take to reach its target. Attack graphs can be expressed in many forms and may be *state-based* or *logical* [24]. A node in a state-based attack graph represents the security state as the combination of compromised hosts. Scalability is an issue, as the network becomes dense with increasing host connectivity. Logical attack graphs represent dependencies between exploits and security conditions. In this work, logical attack graphs are studied.

4.1 | Logical attack graph creation

A scenario is adopted for purposes of illustration, mimicking the control center of the Iranian Natanz plant targeted by the Stuxnet worm (Figure 2, left, adopted from Figure 5 of [41]). The enterprise control network contains *WinCC Web Client*, *Historian Web Client* and *PCS7 web client*. WinCC is a SCADA and HMI system, and PCS7 is the Distributed Control System. These clients accessed the web server through *Web Navigator*, *PCS7*

Web Server and *CAS Server* in the demilitarized zone (DMZ). These servers could interact with the process control components such as *Engineering Workstation*, *Simatic Process Historian* and *PCS7 OS server* to control the PLCs and field devices.

To create the logical attack graph (Figure 2, center), several inputs are used: (1) the configurations of the Access Control Lists in the three firewalls, (2) the vulnerabilities in the web servers in the DMZ, and (3) the potential target, for example, root access to *Engineering Workstation* or *WinCC SCADA server*. Security conditions are represented as circle nodes, for example, adversary has privilege over the host *D: PCS7 Web server*. Vulnerabilities are represented as rectangle nodes, for example, in *Xss_attack(A, B)* an adversary with privilege over *A: PCS7 Web client* can then exploit the cross-site scripting vulnerability in *B: PCS7 Web server*. The probability of the exploitation of the vulnerability to reach a security condition is considered to be based on the *Base Score* of the CVSS (CS) [27]. CVSS scores are in the range of 0–10. For each day in the NVD, the number of exploits and distribution across CVSS scores is calculated (Figure 3), based on actual reported findings. Then, using this distribution, the attack graph's nodes are allocated for a vulnerability (v) with its probability of being exploited (p_v), where p_v is based on the linear relation $p_v = f(CS)$.

4.2 | Conversion to bayesian attack graph

The fusion of a BN with the attack graph makes it a BAG. A BN is introduced for dynamic analysis of attack graphs in Ref. [42]. The nodes represent *random variables*, and the directed edges represent dependencies between them, forming a

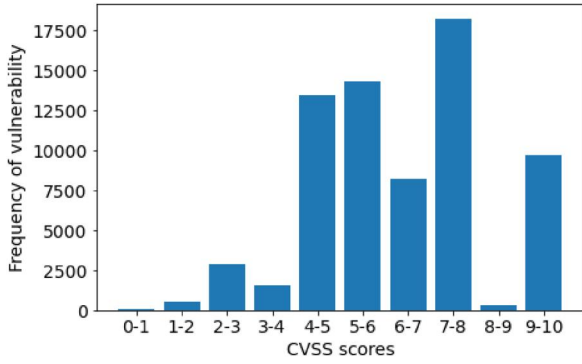


FIGURE 3 Exploitation distribution of different vulnerabilities across Common Vulnerability Scoring System (CVSS) scores existing in the National Vulnerability database (NVD) database [27], over the range of 0–10 on the day of inference.

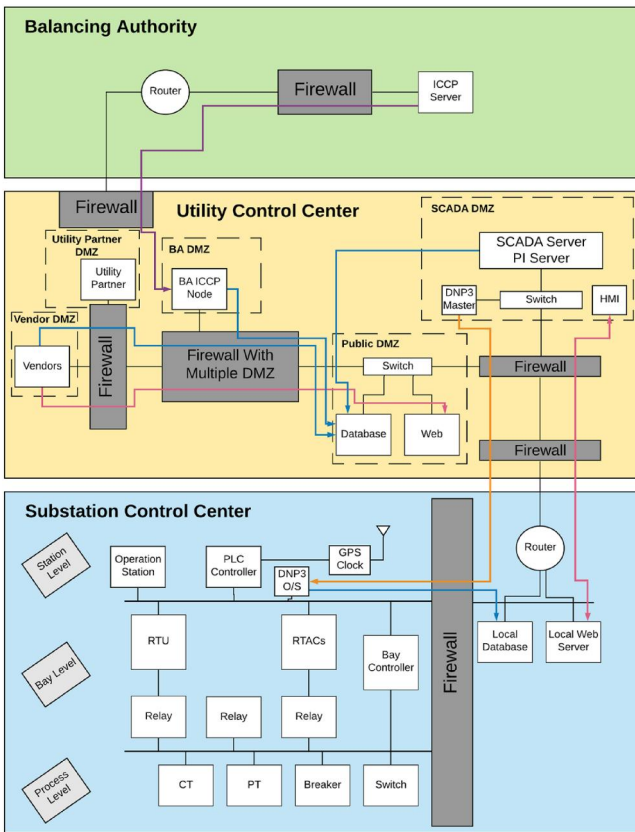


FIGURE 4 Hierarchical architecture of the communication network of Power System with the links indicating the IT and ICS traffic.

Directed Acyclic Graph (DAG) [24]. If monotonicity is assumed, once an adversary escalates a privilege, it never relinquishes it; then, one can remove duplicate paths to construct the DAG. The joint probability distribution of the BAG (Figure 2, right) can be written as:

$$\begin{aligned}
 P(A, B, C, D, E, F, G, H, I, J, PLCs) &= P(A)P(B) \\
 &P(C)P(D | A)P(G | D)P(H | G)P(E | B)P(F | C, E) \\
 &P(I | F, E)P(J | F)P(PLCs | H, I, J)
 \end{aligned} \quad (1)$$

Each node in the BAG represents a security condition, for example, $Privilege(A)$. The CPT of the BAG is then computed as the combined effect of a vulnerability in a network, as used in Ref. [43]. The local CPT of the nodes with logical AND and OR conditions in the BAG are computed as Equation (2), from Ref. [24]. A logical AND signifies that all the permissives are necessary to compromise a node X_i . A logical OR signifies any one permissive is sufficient to compromise a node. The immediate parents of the node X_i are \mathbf{pa}_i , and the probability that vulnerability v_j is exploited is p_{v_j} .

$$\begin{aligned}
 P(X_i | \mathbf{pa}_i) &= \begin{cases} 0, & \exists X_j \in \mathbf{pa}_i | X_j = 0 \\ \prod_{j: X_j} p_{v_j}, & \text{otherwise} \end{cases} \\
 P(X_i | \mathbf{pa}_i) &= \begin{cases} 0, & \forall X_j \in \mathbf{pa}_i | X_j = 0 \\ 1 - \prod_{j: X_j} (1 - p_{v_j}), & \text{otherwise} \end{cases}
 \end{aligned} \quad (2)$$

The computational steps of the BAG model generation of Bayes-CAPS are detailed in Lines 1–10 of Alg. 1. Five use cases are considered in this work, described next.

5 | POWER SYSTEM BAG MODEL GENERATION

Since power systems are critical infrastructure, the real systems have constraints on data sharing, and the real model is Critical Energy/Electric Infrastructure Information (CEII). Hence, the term *synthetic* is adopted to refer to models based on characteristics of real systems that are of the same level of detail, scale and complexity, but do not contain any CEII or represent any specific real-world system, and hence can be shared. For the synthetic models below, Bayes-CAPS generates BAGs, based on cyber-physical architecture and components as detailed in Ref. [16], and performs studies that utilize the models to understand how well the inference techniques work in this environment.

5.1 | Threat model

The threat model in the BAGs that we generate captures the type of vulnerability exploited, as well as the set of permissives that need to be satisfied to exploit the vulnerability in the succeeding node (child node). Based on the type of vulnerability, the CVSS score implicitly reflects the attack strength based on its exploitability component. The set of permissives is based on the parameter p_{OR} , the probability of incorporating OR logic (as opposed to AND logic) in the step(s) between the parent and child nodes. Hence, the threat model for adversary movement is logical in nature, considering OR and AND gates for vulnerability exploitation, with threat intensity regulated through p_{OR} . The notion can be explained through the Darkside Ransomware-as-a-Service attack on the Colonial Pipeline,

where three different parents or affiliates were involved to plant the Backdoor Smokedham in the victim's environment. The UNC2659 affiliate first exploited the CVE-2021-20016 vulnerability of a SonicWall firewall to install Teamviewer and get remote access, while the affiliate UNC2628 utilized the Beacon command and control Botnet framework to run the Mimikatz, a credential theft tool for privilege escalation. Finally, the affiliate UNC2465 plants the .NET backdoor, Smokedham, by sending a phishing email. Hence, for this incident, the event of backdoor access had a $p_{OR} = 0$ as all affiliates needed to execute their steps to finally accomplish the goal. The higher the value of p_{OR} , the higher the chance of exploitability, because there would be more successful ways to target the victim. This method of modelling the threat makes the threat framework generic to attacks of diverse intensity and exploitability.

Other threat scenarios of a false data and command injection attack using an Address Resolution Protocol (ARP) spoof based Man-in-The-Middle (MiTM) attack in the RESLab testbed [44], as well as communication loss via Denial of Service [38], are considered for learning the BAG based on the sensor data from different locations in the emulated network. The specific targets in these attacks are branch statuses and generator set points, based on multiple element contingency selection in large-scale power systems [45]. For extracting real-time data during the threat emulation, the fusion engine [46] is used. The scenario's dataset is available at IEEE Dataport [47]. Bayesian structure learning is considered to understand the dynamics of the attack by modelling the nodes of the BAG as the cyber and physical features extracted at different location of the network. The dynamic details of the attack are elaborated in Figure 2 of Ref. [44], including a detailed timing diagram of the ARP cache poisoning attack on the substation router and the field devices. This forms the basis for utilizing the IP and MAC address-based features from four different locations in the network. The learning techniques are adopted from Ref. [10]. Interested readers are encouraged to review the prior works for an in-depth grasp of this threat model, since the details are outside the scope of this paper.

5.2 | Case studies

Using the steps described in Section 4 and Algorithm 1, the BAGs are generated for different communication networks based on a hierarchical network [16] illustrated in Figure 4. In these networks, an electric grid is divided among several utilities, where each utility owns a set of substations. The utilities or the market participants interact with the balancing authorities at the highest level of the hierarchy. Modelled components include firewalls, routers, RTACs, switches, DMZs and relays. The cases are detailed in Refs. [15, 48] and available [49].

The construction of the graphs is automatic, with the test system generation based on realistic power systems [16, 48] as the first step. An Attack Graph Template is used to construct the attack graph based on inputs that would be collected from the real world power systems, detailed in Refs. [50, 51]: the

firewall rules and information about ports and services running to translate into CVSS scores. Those data can be collected using existing available tools. From those inputs, a cyber-physical attack graph is built (detailed in Ref. [50], code for CYP-SA-Live [52]) that gives the access paths that can be exploited to reach a high-impact target. The process is documented in detail in Refs. [16, 48], with data in Ref. [49]. The attack graph construction and subsequent physics-based risk analysis enables a key value proposition for many different cyber-physical analyses, including this one, that moves from static attack graph to dynamic attack graph in aim of continually mapping a dynamic adversary.

When the attack graph is constructed, it is based on the connectivity model and refined based on the known vulnerability information to preclude links that are unlikely based on the lack of available vulnerability information. To address zero-day vulnerabilities, it is important to note that data-driven probabilistic models depend on the symptoms of an intrusion. Assuming the probability a given node X is compromised is $P(x)$, even if a vulnerability is missed while constructing the BAG (e.g., zero-day exploit), the symptoms of the intrusion would enforce the update of the posterior probability of $P(x)_{post}$. However, symptoms may not be reliable due to untrustworthy sensors. Hence, other works, for example, Ref. [7], that address aleatory uncertainty through the notion of ignorance (analogous to the impact of a zero-day exploit on the symptoms of an intrusion), can be considered. Further, alerts generated from IDS can act as a data source for the structure learning problem to learn the structure of an attack graph based on the prior structure provided by experts [10].

5.2.1 | Single substation model

A utility control centre with a single substation (Figure 4) provides a simple benchmark test case for evaluating effects of different parameters on the performance of Bayes-CAPS. The single substation model also serves as a module in the code that is able to be replicated and parameterized in larger models. This model forms a BN with 29 nodes (17 in the UCC, 12 in the substation). Figure 5 shows the BAG.

5.2.2 | WSCC case with 3 substations

A three-substation network is created based on the WSCC 9-bus case [54], which consists of 4 broadcast domains, one each for the substation and one for the main control centre (Figure 6). This forms a BN with 47 nodes (17 in the UCC, 30 in 3 substations).

5.2.3 | CyPSA 8-substation model

The cyber-physical situational awareness (CyPSA) 8-substation test case [48] contains a node-breaker topology with detailed

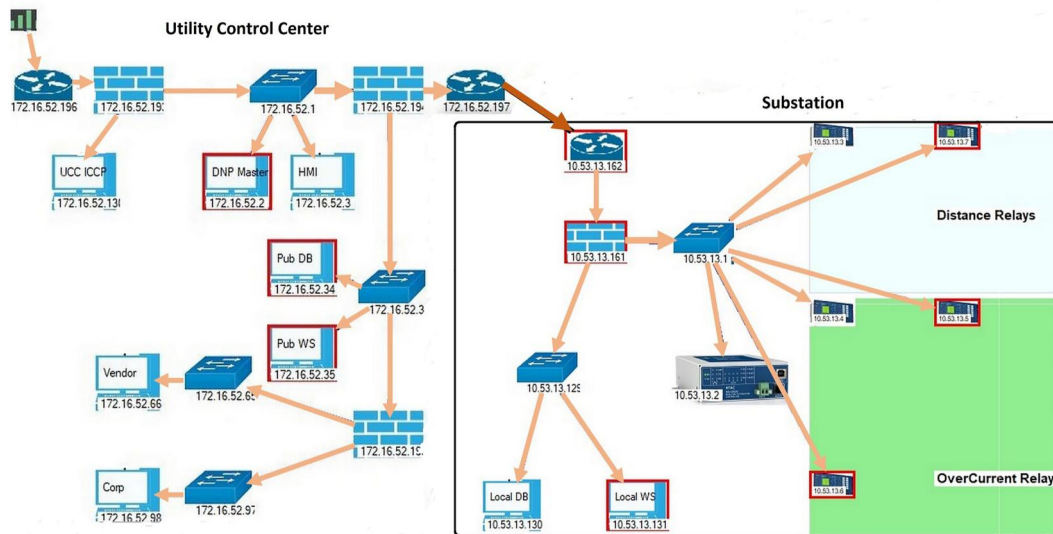


FIGURE 5 Bayesian attack graph for the single substation model; nodes circled in red indicate evidence of compromise.

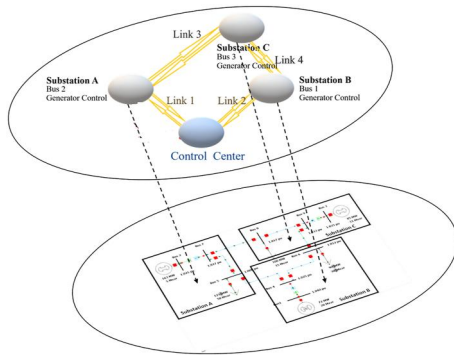


FIGURE 6 WSCC 9-bus cyber-physical model with control center and substations, figure adopted from [53].

cyber and physical interconnections at the substation level. Each substation has multiple buses and control devices, which makes the model dense. There are 52 electrical nodes. Relays, breakers, firewalls and routers are modelled and detailed in Ref. [48]. This forms a BN with 98 nodes (17 in the UCC, 81 in 8 substations).

5.2.4 | IEEE 300-bus system

The IEEE 300-bus power system case is made cyber-physical as detailed in Ref. [55]. This case is used to study the scalability of the proposed model, as it consists of 4500 IP-addressable devices, with 1301 operational devices, that is, relays, and 2384 non-operational devices, for example, fault recorders, alarm systems and batteries. The model has 300 substations, grouped into 20 areas for the experiments. Hence, a total of 21 broadcast domains are considered, and the BN has 217 nodes. This grouping reduces model complexity by reducing the number of nodes from 4500 to 217.

5.2.5 | 2000-Bus synthetic grid

The cyber-physical synthetic electric grid test case [16, 56] with 1250 substations, 2000 buses, 3206 branches and 544 generators is considered in emulation in RESLab under threat scenarios that cause multiple element contingencies. The model is built based on public information and statistical analysis of real power systems, without disclosing any real system information. The emulation of this system is detailed in Ref. [38].

5.3 | Discussion

This work is the first attempt on building BAGs for a large-scale power system model. For BAG nodes that represent the compromise of a relay or RTU, it causes a contingency in the physical (electrical) domain, modelled in Power World Dynamic Studio (PWDS). In the present work, the power domain impact is modelled in a deterministic manner, dictated by the circuit behaviour. For instance, outage of a generator may cause a transmission line to overload and trigger an over-current relay, say $R1$, to open a circuit breaker, which changes the power flow based on the circuit's characteristics, and may trigger some other protection device, say $R2$. In this scenario, the conditional probability of $P(R2|R1)$ is 1, assuming $R1$ to be the parent and $R2$ a child in a sub-graph of the BAG. Integration of renewable generation and variable load profiles can be considered in future work to model probabilistic behaviour of multi-stage contingencies in the physical domain.

A major goal driving our work is to provide a decision support capability under the loss of visibility caused by cyber threats. Conventionally, the control problems in power systems have been considered and addressed using optimization theory. Instead, our work considers how to apply known model information while leveraging RL to improve both the timeliness and accuracy of stakeholder decision-making. Using RESLab

developed for this purpose, it supports formulating and validating the problem as a POMDP. Using Bayesian inference, we compute the posterior probabilities that act as the belief state within the POMDP. In POMDP, once the belief states are learnt, the agent is agnostic to how the posterior probabilities were computed. The solution for the POMDP makes use of BRL which is based on Bayesian inference. Hence, in the current work, we synthetically update the inference against the BAG by altering the p_{OR} values. The environment in the RL space would encounter variability from updated inferences with every evidence. Hence, we analyse the impact of evidence on the inference.

It is important to help stakeholders understand how different evidences impact the inference, which impacts the ability of RL to provide decision support. Analysing the impact on decision support thoroughly involves the fundamentals of RL and is outside this paper's scope. However, as an example, consider an RL episode, where an intruder goal's is to compromise a PLC controller, as in Figure 2. In the episode, the adversary will be compromising the *CAS server*, *PCS7 OS client*, *WinCC Server*, etc., sequentially. Similarly, the defender engine will have to take certain steps to prevent the intrusion. At every stage, the IDS within the RL environment finds an evidence, and the belief state is updated based on Bayesian inference, which impacts the decision/policy of the defender.

This research with power system BAGs reveals a challenge, as it would benefit from real adversary behavioural data to compare. Modelling the prior probabilities of the BAGs needs emulation of red team activities over a long-term duration to capture how an intruder thinks and executes. Estimating the prior probabilities with a large-scale dataset would require exposing the RESLab testbed to an outside world for threat integration, which is currently out of scope due to constraints on allowing outside researchers to deploy their threat strategies. For simplicity, we have hence limited the usage of the data from the emulation to a small network within RESLab for learning the structure of the BN.

6 | APPROACH FOR INFERENCE ON THE BAGS

The BAGs generated based on the cyber-physical model have static attributes if the events within the system do not update the properties like the posterior conditional properties. Each event of intrusion detection must update the BAG attribute by performing inference, called Bayesian inference. It is used to calculate the posterior probability of query variables, given a set of evidences (Figure 7). It computes the unconditional probability distributions to determine the probability that an adversary can reach a security condition. The inference algorithm performs marginalization, that is, summing out the probability of a random variable given the joint probability distribution with other variables. In this work, we adopt and compare four different inference algorithms.

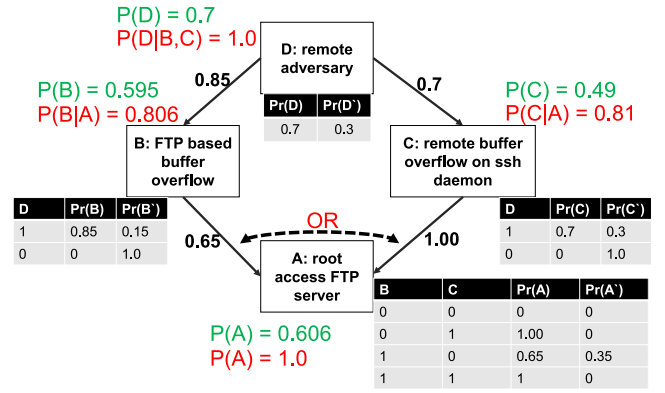


FIGURE 7 Evaluation of the impact of evidence in a small a BAG, showing CPTs for each node. Initial prior probabilities (e.g., the prior on D is $P(D) = 0.7$) are shown in green. Posteriors (given evidence that A is compromised) are shown in red.

6.1 | Understanding the notion of evidence

To illustrate the notion of evidence, we consider a simple BAG from the Ref. [57], shown in Figure 7. Here, the remote adversary targets root access to an ftp server by performing buffer overflow attacks by means of two paths, through B (exploiting an ftp vulnerability) or C (exploiting a ssh vulnerability). The figures shown in the edges of the BAG are the CVSS scores. The unconditional probability for the given BAG, given the prior probability of $P(D) = 0.7$, is computed as:

$$\begin{aligned}
 P(B) &= \sum_D P(B|D)P(D) = 0.595 \\
 P(C) &= \sum_D P(C|D)P(D) = 0.49 \\
 P(A) &= \sum_{B,C,D} P(A, B, C, D) = 0.606
 \end{aligned} \tag{3}$$

Then, assume an evidence is obtained at the node A that confirms it to be compromised, that is, $P(A) = 1$. Then, the posterior probabilities at node C, B and D are altered based on Bayes theorem:

$$\begin{aligned}
 P(C|A) &= P(A|C)P(C)/P(A) = 0.49/0.606 = 0.81 \\
 P(B|A) &= P(A|B)P(B)/P(A) = 0.806, \text{ as} \\
 P(A|B) &= \sum_C P(A|B=1, C)P(C) = 0.8215 \\
 P(D|B, C) &= P(B, C|D)P(D)/P(B, C) = 1.0, \text{ as} \\
 P(B, C|D) &= P(B|D)P(C|D) = 0.85 \times 0.7 = 0.595 \\
 P(B, C) &= \sum_{A,D} P(A, B, C, D) = 0.4265
 \end{aligned} \tag{4}$$

Every time a new evidence is obtained, the BAG is dynamically updated, as in Figure 7. Updating the posterior based on multiple evidences is similar to our prior work on multi-sensor fusion work [7] based on DSTE and its rules of combination.

6.2 | Belief propagation with factor graphs (BP_FG)

A factor graph is a bipartite graph containing variable nodes and factor nodes, and the edges always connect nodes of different types. The joint probability distribution for the BAG in Figure 7, is the following,

$$P(a, b, c, d) = P_a(a)P_b(b)P_{c|a,b}(c|a, b)P_{d|c}(d|c) \quad (5)$$

whose factor graph is shown in Figure 8, where green and yellow denote the variable and factor nodes, respectively. We then compute the marginals and conditionals by passing messages (or propagating beliefs) on the factor graph. This algorithm is widely known as the sum-product algorithm, based on three steps:

1. Marginalization at variable node: Marginals are the product of all incoming messages from neighbour factors (Equation (6)),

$$P(v) = \prod_{f \in F_v} m_{f \rightarrow v}(v) \quad (6)$$

where the $m_{f \rightarrow v}(v)$ is the message from neighbouring factor node f to variable node v , and F_v is the set of all factor nodes neighbour to v . Then, for example, $P(c)$ in Figure 8 is the following:

$$P(c) = m_{P_{c|a,b} \rightarrow c}(c) m_{P_{d|c} \rightarrow c}(c) \quad (7)$$

2. Operation at factor node: Messages from factors sum out all variables except the receiving one. For example, the message from factor node $P_{c|a,b}$, say f , to variable node c in Figure 8 is the following:

$$m_{f \rightarrow c}(c) = \sum_a \sum_b f(c|a, b) m_{a \rightarrow f}(a) m_{b \rightarrow f}(b) \quad (8)$$

3. Operation at intermediate variable node: Messages from variables are the product of all incoming messages except from the receiving factor. For example, the message from variable node a to factor node $P_{c|a,b}$ in Figure 8 is the following:

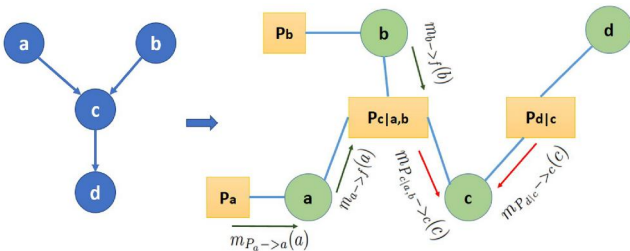


FIGURE 8 The factor graph with message passing for the BAG in Figure 7

$$m_{a \rightarrow f}(a) = m_{P_a \rightarrow a}(a) \quad (9)$$

6.3 | Pearl's belief propagation

PBP computes the belief distribution of a random variable X in the BN. The distributions are computed using three types of parameters: a) causal support (π), b) diagnostic support (λ) and c) the CPT. The CPT is described in Ref. [25] and illustrated in Figure 7. The algorithm initiates from the node where a new evidence is obtained, following three steps [25]:

1. Belief updating: The node updates its belief based on the message it receives from parents, through causal support (π), and the message it receives from children, through diagnostic support (λ):

$$Bel(X) = \alpha \lambda(X) \pi(X) \quad (10)$$

2. Bottom-up propagation: The node computes a new message $\lambda_X(u)$ based on its CPT and messages λ received from its children.

$$\lambda_X(u) = \sum_X \lambda(X) P(X|u) \quad (11)$$

3. Top-down propagation: The node computes a new message π and that it sends to its children. The new message $\pi_{Y_j}(x)$ for its j th child Y_j is calculated as follows:

$$\pi_{Y_j}(X) = \alpha \pi(X) \prod_{k \neq j} \lambda_{Y_k}(X) \quad (12)$$

Two different variants are considered, $PBP-P$ and $PBP-T$, where $PBP-P$ parallelly starts the BP and can update the posteriors for BAGs with loops. $PBP-T$ sequentially performs BP and only works in BAGs without loops.

6.4 | Variable elimination

The VE method groups together factors that involve the same variables, then marginalizes those variables. For example, considering the BAG from Figure 2, the probability that an adversary gains to access the PLCs is $p(PLCs)$,

$$P(PLCs) = \sum_{A,B,C,D,E,F,G,H,I,J} P(A)P(B)P(C) P(G|D)P(D|A)P(H|G)P(E|B)P(F|C,E) P(I|F,E)P(J|F)P(PLCs|H,I,J) \quad (13)$$

where after factorization, that is, splitting the joint distribution into conditional and marginal probabilities, Equation (13) above becomes:

$$\begin{aligned}
P(PLCs) &= \sum_{H,I,J} P(PLCs | H, I, J) \sum_{F,E,G} P(H | G) \\
&P(J | F) P(I | F, E) \sum_C P(C) P(F | C, E) \\
&\sum_B P(B) P(E | B) \sum_D P(G | D) \sum_A P(A) P(D | A)
\end{aligned} \quad (14)$$

Then, Equation (14) is evaluated from right to left by recursively eliminating all the variables in the BAG except the *PLCs* by following the elimination order = *A, D, B, C, F, E, G, H, I, J* using the bucket elimination algorithm [35]. The complexity of the bucket elimination algorithm is $O(nw^*)$, where n is the number of nodes, and w^* is the induced tree width [35]. The induced tree width is dependent on the BAG structure.

The VE method is advisable for BAGs with more depth and less induced tree width, that is, when number of vulnerabilities per node is low or access paths are long. For large systems, exponential blow-up while computing marginal probabilities is addressed by identifying factors in the joint distribution that depend on selected variables, then computing them once and storing the results [24]. Finding optimal elimination order is dependent on the induced graph (a graph generated at every stage of VE). The optimal order depends on the BAG topology and node elimination order criteria such as min-neighbours, min-fill [24].

6.5 | Junction tree

The Junction Tree (JT) method uses the message passing algorithm as in Ref. [34] for loopy BNs. The objective is to create a tree where each node represents a collection of random variables (security states in BAGs) and apply the message passing scheme to compute the unconditional probabilities. We use the *chordal graph* method for obtaining the JT in this work, as shown in Figure 9. A chordal graph is a graph in which every cycle of length four and greater has a cycle chord. Moralization converts the BAG to an undirected graph, triangulation converts the undirected graph to a chordal graph and the chordal graph is converted to the JT.

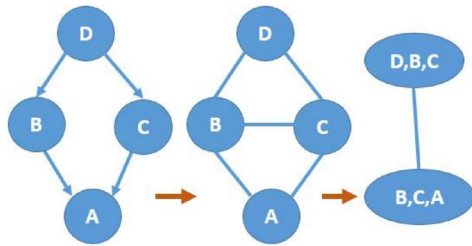


FIGURE 9 The junction tree formed from the BAG, using moralization followed by triangulation to construct the chordal graph, for the example in Figure 7.

Assuming the BAG has discrete nodes with binary values (compromised or not), JTs scale in time and space as $O(|F|r^s)$, where $|F|$ is the number of factors, $r = 2$ possible discrete values and s is the size of the largest factor [24], which depends on the network topology. Higher interconnectivity correlates with a larger s value.

7 | BAG INFERENCE PSEUDOCODE

The following variables and parameters are defined for the experiments. N is the total number of nodes, u is the maximum number of parents per node, C is the number of clusters, N_{Per_Ctr} is the number of nodes per cluster, Sim_Count is the number of simulation for a unique configuration, *dag* is the adjacency matrix representing the graph, etc.

Algorithm 1 provides the overall Bayes-CAPS pseudocode. First, it constructs the DAG (*ConstructDAG()*, Algorithm 2). Then, it converts the DAG to a BAG by building the CPT for each node (*CreateCPD()*, Algorithm 3). For the use cases, Bayes-CAPS constructs the initial BAGs. Then, Alg. 1 infers the posterior probabilities using four different techniques (Section 6). The inference algorithms are tested by changing the engine variable. Bayes-CAPS uses *var_elim_inf_engine* for VE, *pearl_inf_engine* for Pearl's BP, and *jtree_inf_engine* for junction tree based inference. The functions *mk_net*, *bnet_to_fgraph*, *belprop_fg_inf_engine*, *enter_evidence* and *marginal_nodes* are utilized from BayesNet libraries.

Algorithm 2 and Algorithm 3 are used in Algorithm 1 as follows. *ConstructDAG()* (Algorithm 2) creates initial DAGs, without assuming knowledge of the network ahead of time, by randomly picking edges while meeting the constraint of u . The variable *dag_mod* is the modified DAG used to update the *dag* for each cluster; *dag* is then used to create links between the clusters. For the cyber-physical power system models, the DAGs are constructed based on the topology generated from the hierarchical synthetic communication models (Section 5) instead of Algorithm 2. To convert the DAGs to BAGs, *CreateCPD()* (Algorithm 3) constructs the conditional probability distribution of each node. The *n_{pa}* computes the number of parents of node i . Parentless nodes are assigned the prior probabilities based on the CVSS scores, CS , discussed in Section 4.2. The nodes with parents are assigned the conditional probabilities depending on the probability of logical OR, p_{OR} , and Equation (2) (Line 6–10 of Algorithm 3).

In the experiments, N (Algorithm 1, line 1) and node density dictated by u (Algorithm 1, line 2) are varied. In every experiment, 20 simulations (Algorithm 1, line 1, *Sim_Count*) are run for calculating the average computation time and average accuracy. The u is varied from 2 to 5 (Algorithm 1, line 2), since most attack-originating nodes exhibit a fan-in in that range (Figure 7 of [58]). The complexity and stealthiness of attack depends on both u and p_{OR} . The dynamic update of the posterior probabilities (Algorithm 1, lines 13–19) based on the

alerts will help update access paths to critical assets such as PLCs, relays, etc.

Algorithm 1 Bayes-CAPS Pseudocode

```

1: Define  $C, N, Sim\_Count, dag, p_{OR}$ 
2: for  $u = 2$  to  $5$  do
3:   for  $e = 0$  to  $3$  do
4:     for  $sim = 1$  to  $Sim\_Count$  do
5:        $dag = ConstructDAG(u, C, N, dag)$ 
6:        $bnet = mk\_net(dag, C*N, node\_type)$ 
7:       for  $i = 1$  to  $C*N$  do
8:          $d = dag(:, i)$ 
9:          $bnet.cpd(i) = CreateCPD(p_{OR}, d, i, bnet)$ 
10:      end for
11:       $fg = bnet\_to\_fgraph(bnet)$ 
12:       $eng = belprop\_fg\_inf\_engine(fg)$ 
13:       $evi =$  vector with  $1$  to  $e$  set  $1$  rest  $0$ 
14:       $upd\_eng = enter\_evidence(eng, evi)$ 
15:      define posterior to store updated probabilities
16:      for  $j = 1$  to  $C*N$  do
17:         $marg = marginal\_nodes(upd\_eng, j)$ 
18:         $posterior(j) = marg$ 
19:      end for
20:      end for
21:      Compute average computation time
22: end for
23: end for

```

Algorithm 2 ConstructDAG(u, C, N, dag)

```

1: for  $j = 1$  to  $C$  do
2:   Define  $dag\_mod$  for cluster  $j$ 
3:   for  $i = 2$  to  $N$  do
4:     Create edges randomly for each node  $i$  in cluster  $j$  having maximum number of parents  $u$ 
5:     Update  $dag\_mod$ 
6:   end for
7:   Update  $dag$  for cluster  $j$  from  $dag\_mod$ 
8:   Create random edges between any node in the cluster  $j$  and the rest of the clusters.
9:   Update  $dag$  with new edges.
10: end for
11: return  $dag$ 

```

Algorithm 3 CreateCPD($p_{OR}, dag, i, bnet$)

```

1:  $npa = sum(dag(:, i))$ 
2: if  $npa = 0$  then
3:    $CS = getCVSS(np_a)$ 
4:    $cpt = f(CS) \triangleright$  Assign prior probabilities (Section 4.2)
5: else
6:   if  $rand(1) \leq p_{OR}$  then
7:      $cpt = OR\_CPT(prob)$ 
8:   else
9:      $cpt = AND\_CPT(prob)$ 
10:  end if
11: end if
12: return  $tabular\_CPD(bnet, i, cpt)$ 

```

8 | RESULTS AND ANALYSIS

In this section, the experimental results are presented that compare the performance and accuracy of the Bayes-CAPS algorithms. The results in this section leverage the BayesNet MATLAB library [59].

8.1 | Analysis of inferencing algorithms on random BAGs

Before considering the BAGs generated for the cyber-physical power system case-studies, we first consider random construction of BAGs to study the sensitivity of inference with respect to graph density and impact of evidence. Since more vulnerabilities make the BAG dense, evidence of intrusion detection at a node is useful, because it assists in updating the posterior belief on a node. The IDSs may not always detect a specific exploitation, for example, due to disabled pre-processors to prevent latency. Moreover, the nodes monitored for security may vary, effecting the evidence. Hence, in the experiments, it is studied whether the evidence can reduce the computation time and improve accuracy of inference.

The substation network in Figure 5 has 6 cyber nodes and 6 physical devices, for example, relays. In the experiments, N is varied from 6 to 14. Figure 10a and Figure 10b evaluate average computation time without and with evidence, respectively, using *BP_FG*. Figure 10a shows that as N increases and as u increases, the average computation time increases, for example, 0.2 s ($u = 2$) to 0.27 s ($u = 5$) in the 14-node BAG. The probable reason is that an increase in u causes more multiplicative operations in the factor node (step 3 of *BP_FG*, Section 6.2). From Figure 10b, the evidence reduces computation time, for example, by $\sim 50\%$ in the 6-node BAG.

Figure 11a and Figure 11b evaluate computation times using *VE*. Figure 11a shows increased computation time with increased number of nodes. Unlike in *BP_FG*, varying u did not affect the computation time in a specific pattern. For a

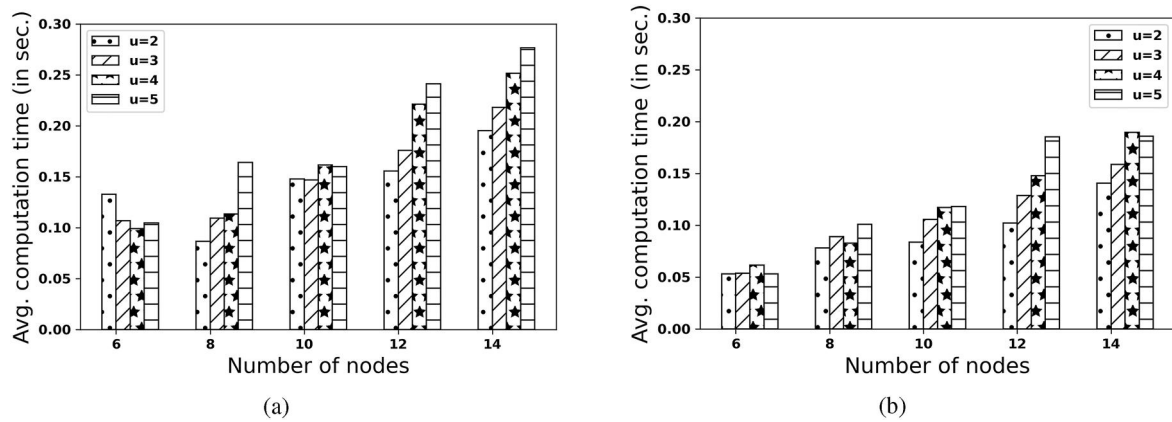


FIGURE 10 Evaluation of computation time using Belief Propagation using Factor Graphs (a) with no evidence, and (b) with evidence.

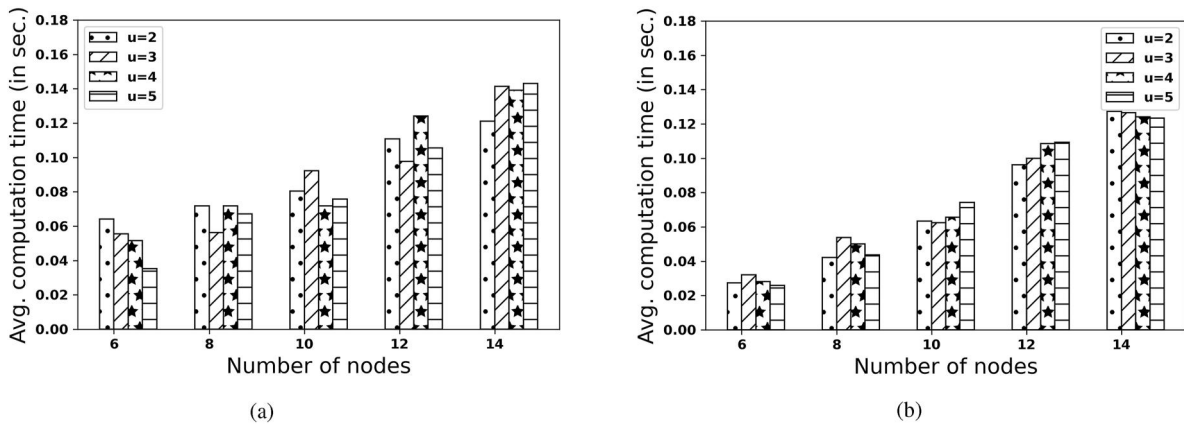


FIGURE 11 Evaluation of computation time using Variable Elimination (VE) (a) with no evidence, and (b) with evidence.

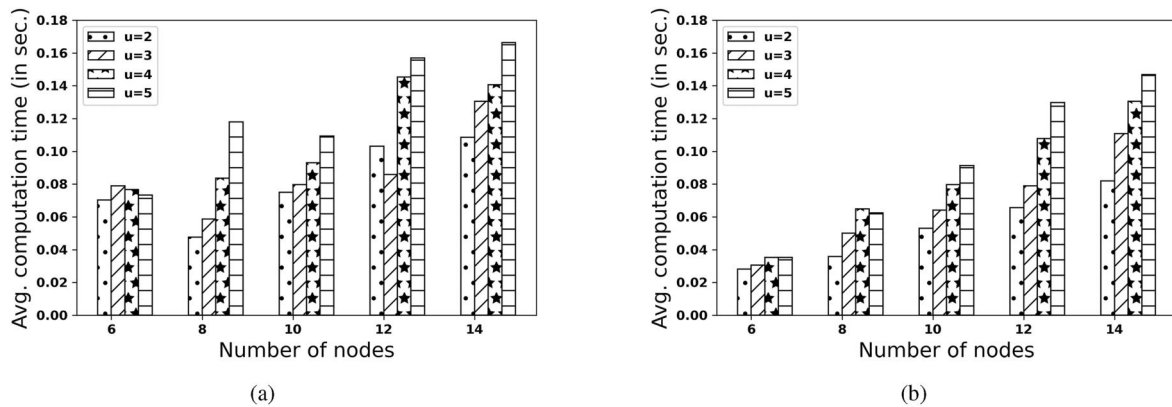


FIGURE 12 Evaluation of computation time using Pearl's Belief Propagation Algorithm (a) with no evidence, and (b) with evidence.

fixed number of nodes, as u increases, the induced width of the tree must increase with a decrease in the depth of the tree. Hence, we would expect the computation time to grow as u increases, but the complexity also depends on the order of elimination which affects the size of the intermediate factor. The evidence reduces the computation time of *VE*. Figure 11b

shows the reduction from almost 0.06–0.02 s when a single evidence was found (for $N = 6$, $u = 2$).

Figure 12a and Figure 12b evaluate computation times using *PBP*. For larger N , it is observed that as u increases, the computation time also increases from 0.1 s ($u = 2$) to 0.16 s ($u = 5$) for the 14-node BAG. The increase in computation

time with u is due to increase in number of *top-down propagation* operations that involve multiplicative operations, as discussed in Section 6.3. In Figure 12b, the computation time reduces from almost 0.07–0.02 s when a single evidence is found (for $N = 6, u = 2$).

The *JT* method is preferred because it works when there are loops in the BAGs. Figure 13a and Figure 13b evaluate the *JT* method without and with evidence. Unlike the previous three methods, the computation time does not increase as N increases, because the number of nodes in the *JT* does not depend completely on the number of nodes in the original graph. The structure and size of the *JT* is dependent on the chordal graph, formed as discussed in Section 6.5.

8.2 | Comparison of bayesian inference techniques

For comparing the inference algorithms, synthetic graphs are generated as above, but now with a cluster structure [24], where in each cluster, the number of nodes is the same. Such BAGs with a clustered structure are considered, modelling the ease of vulnerability exploitation within each LAN, broadcast

domain or cluster. Conventionally, there are more intra-cluster access paths in comparison to inter-cluster paths. For each cluster, we generate pseudo-random subgraphs with a maximum number of parents for each node u . Figure 14 show the average computation time using the inference algorithms, with $u = 2$ and $u = 5$, respectively. Drawing an analogy with the single substation model (Figure 5) for the synthetic network, 2 clusters with a cluster size of 10 are considered, as shown in Figure 15a,b. It can be observed that the *JT*



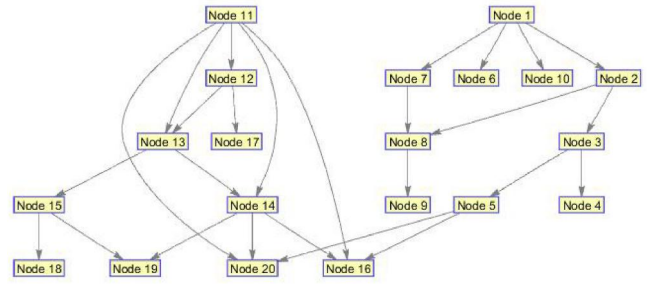


FIGURE 15 A clustered Bayesian Attack Graph with 2 clusters and 10 nodes in each cluster.

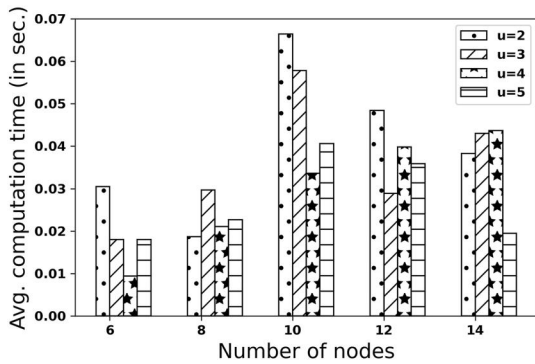


(a)

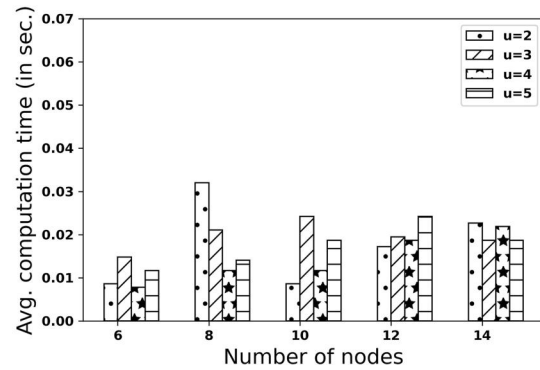


(b)

FIGURE 13 Evaluation of computation time using Junction Tree with (a) no evidence, and (b) with evidence.

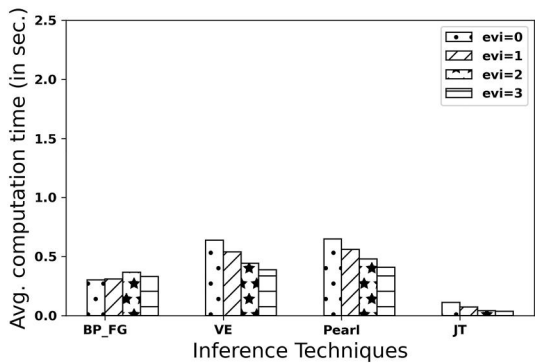

(a)

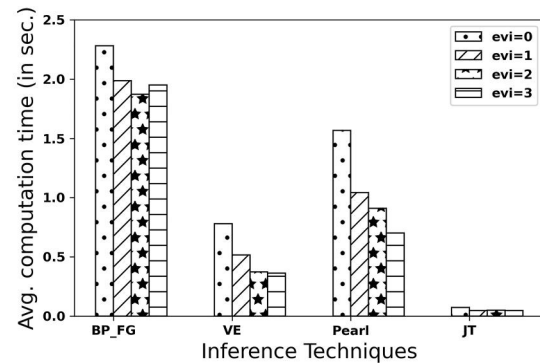

(b)

FIGURE 14 (a) Comparison of inference techniques with maximum allowed parents ($u = 2$), with varying no. of observed nodes; (b) Comparison of inference techniques with maximum allowed parents ($u = 5$), with varying no. of observed nodes.

algorithm is faster in comparison to other methods. Table 1 shows the comparison of the inference techniques on the basis of scalability, evidence dependence, computation time, loops and accuracy.

In our experiments, we alter the number of evidence sources (observable nodes) from 0 to 3, which implies for those nodes, the IDS sends an alert with 100% probability. As the number of evidences increases, the computation time for all the methods decreases.

8.3 | Evaluation of inferencing algorithms on BAGs generated from power system use cases

The accuracy of the inferred posterior probabilities are calculated based on the root mean square error with reference to an exact inference algorithm such as the *JT* method. Among the techniques considered in this work, *BP_FG* and *PBP* are the approximate inference algorithms. Figure 16 evaluates the accuracy of the inference techniques for the 8-sub dense network case with loops. *BP_FG* outperforms *PBP-T* variant of *PBP*. The BAGs considered for the other use cases without loops have no error in inference. With the increase in evidence, the inference error is reduced for both techniques, except for *BP_FG* with more error for $evi = 3$ compared to $evi = 2$.

Figure 17 indicates how the computation time increases logarithmically as the size of the grid increases (from 29 nodes

TABLE 1 Inference method comparison

Technique	Scale	Evi. Dep.	Comp.	Loops	Accuracy
BP_FG	✗	✓	✗	✓	✓
VE	✗	✓	✗	✓	N.A.
PBP-P	✓	✓	✓	✓	✓
JT	✓	✓	✓	✓	N.A.
PBP-T	✓	✓	✓	✗	N.A.

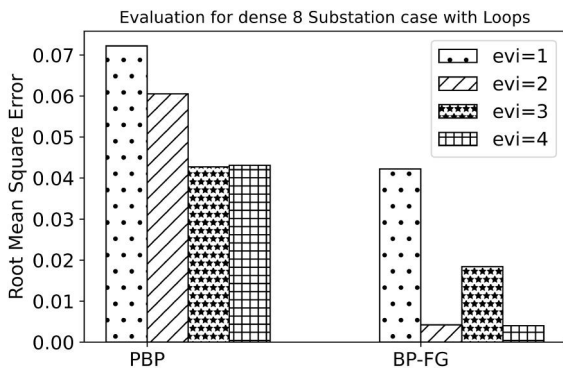


FIGURE 16 Error evaluation of the approximate inference algorithms.

in 1-sub case to 217 nodes in IEEE 300 case). *PBP-T* performs faster than other techniques. It can be observed that the 8-sub case cannot be solved using *PBP-T* due to loops in the BAG. Results show that *JT* is the preferred technique.

8.4 | Evaluation with varying threat intensity

The threat intensity is varied by modifying p_{OR} , as introduced in Section 7. We evaluate how the accuracy of the approximate inference algorithms are affected by altering p_{OR} for the 8-substation case with loops. Table 2 indicates that as the threat intensity increases (increase in p_{OR}), the computation time increases due to increased message passing. The accuracy of inference using *BP_FG* decreases, while such trend is not observed for *PBP*. Based on Figure 16 and Table 2, it can be concluded that *BP_FG* is preferred over *PBP*, though the latter technique is not highly dependent on threat intensity. With the highest threat intensity of $p_{OR} = 1$, *BP_FG* error is still less than *PBP*.

8.5 | Feature-based BAG structure learning

This section analyses the structure learning problem, leveraging RESLab that emulates the MiTM attacks, as

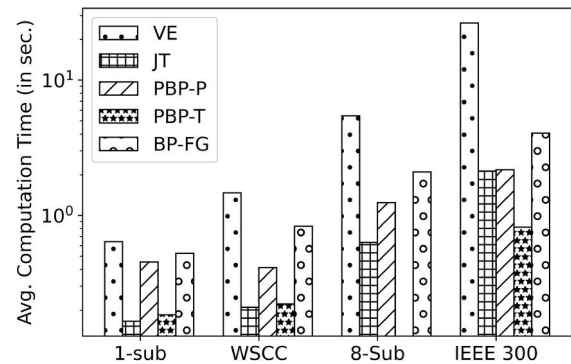


FIGURE 17 Inference computation times for four power system cases.

TABLE 2 Impact of p_{OR} on the accuracy and computation times of the approximate inference algorithms

p_{OR}	8-Sub		BP_FG	
	PBP RMSE	Comp. Time	RMSE	Comp. Time
0.0	0.0763	0.5645	0.0027	1.4427
0.2	0.0639	0.5314	0.0056	1.4638
0.4	0.0495	0.6019	0.0079	1.4767
0.6	0.059	0.5855	0.0097	1.5102
0.8	0.0467	0.6195	0.0108	1.7923
1.0	0.0429	0.7113	0.0121	1.8869

introduced in Section 5.1 and 5.2.5. The cyber and physical features extracted from the emulation, presented in Ref. [46], form the nodes in the BAG. The relationships or causal links between the nodes are learned using the Chow Liu and K2 algorithms in Ref. [10]. The experiment is performed on the use case where the measurements are tampered [38]. First, two physical measurements, the real power generation values in MW of two generators that were targeted in the UC3 MiTM attack, are extracted from three different locations in the emulated network: the node where DNP3 master runs (M), the substation router (R) and the node that runs PWDS, that is, DNP3 outstations (O) (Figure 18), making a six-node BAG (two measurements per location). During the attack, the measurement the router receives from the intruder spoofing the outstation is a modified value compared to that sent by the benign outstation. Hence, the learned structure for the dataset with attack must reduce the correlation between node O and R for both the measurements, that is, it either removes the link or reduces the conditional probability $P(R|O)$ in comparison to the dataset with no compromise. The structure learned from the Chow-Liu algorithm (Figure 18) is $(R1, M1)$, $(M1, O1)$, $(M1, O2)$, $(O2, R2)$, $(R2, M2)$, while from the K2 algorithm is $(O1, M1)$, $(R1, M1)$, $(R1, O1)$, $(R2, M2)$. The 1 and 2 indices in the BAG nodes denote the first and second generator identifiers, respectively. Since both $(R1, M1)$ and $(R2, M2)$ exist in both solutions, it clearly shows that the intruder is in the substation LAN, that is, modification of a measurement in the DNP3 packet occurred before the packet left the substation router R .

Next, cyber features of source and destination MAC address from the three location are considered, making a six-node BAG. The structure learned from the Chow-Liu algorithm is $(O1, R1)$, $(O1, R2)$, $(R2, O2)$, $(R2, M1)$, $(M1, M2)$ and from the K2 algorithm is $(M1, M2)$, $(O2, R2)$, $(O2, O1)$, $(R2, O1)$, $(O1, R1)$. The 1 and 2 indices denote the source and destination MAC address, respectively. In the ARP spoof attack, the packet received at the router from the intruder will have a different source MAC address from the MAC address of the outstation. Similarly, the packet received at the outstation from the intruder will have a different source MAC address from the MAC address of the router. Existence of $O1, R1$ in both the techniques indicate that both the router and the outstation received packets from the intruder.

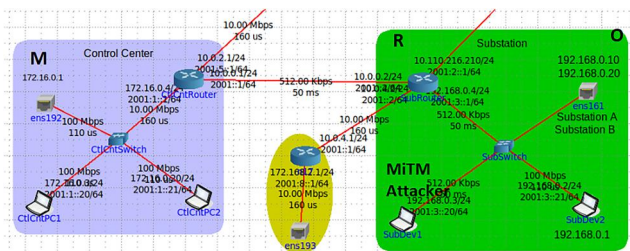


FIGURE 18 Testbed configuration, with measurements and features extracted from the DNP3 master (M), a substation router (R), and a DNP3 outstation (O).

The existence of some unwanted links can be reduced by collecting a dataset from emulation over a longer period. From the law of large numbers, the average of the results from a large number of trials should be close to the expected value. Hence, computing the mean of the prior distribution, with less variance, will improve with more data.

9 | CONCLUSION

Better modelling and visibility of dynamic adversary behaviour can improve power system attack-resilience. The major contributions of this paper are generation of BAGs, analysis and comparison of inference algorithms based on scale, evidence dependency, time complexity, accuracy and loops for different power system use-cases. Some major conclusions drawn are the following: BP with factor graphs is computationally expensive for BAGs with high average in-degrees; hence, it can only work when nodes have fewer vulnerabilities and in smaller networks. Junction tree-based inference outperformed the other three techniques based on its low computation time and scalability to large networks. Evidence plays a major role in effecting the complexity of the inference algorithms. Hence, the inference algorithms should be considered based on the sensitivity of the IDSs to intrusions. *Variable Elimination* and *JT* methods should be used for exact inference, and *PBP* can be used for approximate inference in loopy BAGs. Accuracy of the approximate inference algorithms depends on the network density and the attack strength, regulated through p_{OR} . *BP_FG* should be considered for higher accuracy and *PBP-P* for faster inference. Finally, a Bayesian framework is developed within a cyber-physical EMS for evaluation and comparison of inference algorithms for different power system use cases.

Future work remains on collecting the information in reality, as the exact estimate of the complexity and cost associated with this approach for a given utility remains an open challenge to be better understood. What is known is that utilities are moving in this direction, and there are a lot of existing data sources that are already being collected, with these objectives in mind. Hence, this work intends to help electric power utilities do this work in their own systems, as it can seed new defense toolsets that domain experts can advise stakeholders towards real implementation in practice. Bayes-CAPS is currently part of the suite of CYPRES prototype tools. The current work provides the details of the approach and implementation, including the pseudocode and algorithms. Future work will look to create a standalone opensource tool and data archive.

AUTHOR CONTRIBUTIONS

Abhijeet Sahu: Conceptualization; Data curation; Formal analysis; Investigation; Methodology; Resources; Software; Validation; Visualization; Writing – original draft. **Katherine Davis:** Conceptualization; Investigation; Methodology; Project administration; Supervision; Validation; Writing – review & editing.

ACKNOWLEDGEMENTS

This research is supported by the US Department of Energy's (DOE) Cybersecurity for Energy Delivery Systems program under award DE-OE0000895.

CONFLICT OF INTEREST

The author declares that there is no conflict of interest that could be perceived as prejudicing the impartiality of the research reported.

DATA AVAILABILITY STATEMENT

Data available on request from the authors.

ORCID

Abhijeet Sahu  <https://orcid.org/0000-0002-7647-3758>

REFERENCES

- Falliere, N., Murchu, L.O., Chien, E.: W32. stuxnet dossier. In: White Paper, Symantec Corp., Security Response 5, 6 (2011)
- E-ISAC: Analysis of the Cyber Attack on the Ukrainian Power Grid Defense Use Case
- Targett, E.: High Voltage Attack: EU's Power Grid Organisation Hit by Hackers (2020). [Online]. <https://www.cbronline.com/news/eu-power-grid-organisation-hacked>
- Wang, J., et al.: A method for information security risk assessment based on the dynamic bayesian network. In: 2016 International Conference on Networking and Network Applications (NaNA), pp. 279–283 (2016)
- Jha, S., Sheyner, O., Wing, J.: Two formal analyses of attack graphs. In: Proceedings 15th IEEE Computer Security Foundations Workshop, pp. 49–63. CSFW-15 (2002)
- Li, Y., Chen, J., Feng, L.: Dealing with uncertainty: a survey of theories and practices. *IEEE Trans. Knowl. Data Eng.* 25(11), 2463–2482 (2013). <https://doi.org/10.1109/tkde.2012.179>
- Sahu, A., Davis, K.: Inter-domain fusion for enhanced intrusion detection in power systems: an evidence theoretic and meta-heuristic approach. *Sensors* 22(6), 2100 (2022). [Online]. <https://doi.org/10.3390/s22062100> <https://www.mdpi.com/1424-8220/22/6/2100>
- FireEye: Shining a Light on Darkside Ransomware Operations (2021). [Online]. <https://www.fireeye.com/blog/threat-research/2021/05/shining-a-light-on-darkside-ransomware-operations.html>
- Vlassis, N., et al.: Bayesian Reinforcement Learning, pp. 359–386. Springer Berlin Heidelberg Berlin (2012). [Online]. https://doi.org/10.1007/978-3-642-27645-3_11
- Sahu, A., Davis, K.: Structural learning techniques for bayesian attack graphs in cyber physical power systems. In: 2021 IEEE Texas Power and Energy Conference (TPEC), pp. 1–6 (2021)
- Xie, P., et al.: Using bayesian networks for cyber security analysis. In: 2010 IEEE/IFIP International Conference on Dependable Systems Networks, pp. 211–220 (2010)
- Wang, W., Lu, Z.: Cyber security in the smart grid: survey and challenges. *Comput. Network.* 57(5), 1344–1371 (2013). [Online]. <https://doi.org/10.1016/j.comnet.2012.12.017> <https://www.sciencedirect.com/science/article/pii/S1389128613000042>
- Gaudet, N., et al.: Firewall configuration and path analysis for smartgrid networks. In: 2020 IEEE International Workshop Technical Committee on Communications Quality and Reliability (CQR), pp. 1–6 (2020)
- Davis, K.: An energy management system approach for power system cyber-physical resilience. In: Invited Position Paper for 2021 Virtual Workshop on Cyber Experimentation and Science of Security (CESoS) (2021)
- Sahu, A., et al.: A framework for cyber-physical model creation and evaluation. In: 2019 20th International Conference on Intelligent System Application to Power Systems (ISAP)
- Wlazlo, P., et al.: A cyber topology model for the Texas 2000 synthetic electric power grid. In: 2019 Principles, Systems and Applications of IP Telecommunications (IPTComm), pp. 1–8 (2019)
- Le, T., Hadjicostis, C.N.: Graphical inference for multiple intrusion detection. *IEEE Trans. Inf. Forensics Secur.* 3(3), 370–380 (2008). <https://doi.org/10.1109/tifs.2008.928536>
- Frigault, M., Wang, L.: Measuring network security using bayesian network-based attack graphs. In: 2008 32nd Annual IEEE International Computer Software and Applications Conference, pp. 698–703 (2008)
- Jemili, F., Zaghoud, M., Ahmed, M.B.: A framework for an adaptive intrusion detection system using bayesian network. In: 2007 IEEE Intelligence and Security Informatics, pp. 66–70 (2007)
- Wu, P., et al.: Recognizing intrusive intention based on dynamic bayesian networks. In: 2009 International Symposium on Information Engineering and Electronic Commerce, pp. 241–244 (2009)
- Mengshoel, O.J., et al.: Probabilistic model-based diagnosis: an electrical power system case study. In: IEEE Transactions on Systems, Man, and Cybernetics – Part A: Systems and Humans, vol. 40, pp. 874–885 (2010)
- Delfino, B., et al.: An expert system for alleviating overloads in electric power systems: general concepts and applications. In: [1988] Proceedings. The Fourth Conference on Artificial Intelligence Applications, pp. 299–304 (1988)
- Peerzada, A., et al.: On estimation of equipment failures in electric distribution systems using bayesian inference. In: 2021 54th Hawaii International Conference on System Sciences, pp. 3131–3140 (2021)
- Muñoz-González, L., et al.: Exact inference techniques for the analysis of bayesian attack graphs. *IEEE Trans. Dependable Secure Comput.* 16(2), 231–244 (2019). <https://doi.org/10.1109/tdsc.2016.2627033>
- Ren, W., et al.: Captar: causal-polytree-based anomaly reasoning for scada networks. In: In 2019 IEEE International Conference on Communications, Control, and Computing Technologies for Smart Grids (Smart-GridComm), pp. 1–7 (2019)
- Aksu, M., et al.: Automated Generation of Attack Graphs Using Nvd, vol. 03, pp. 135–142 (2018)
- National Institute of Standards and Technology (NIST): National Vulnerability Database. [Online]. <https://nvd.nist.gov/vuln-metrics/cvss>
- Jia, Y., et al.: A practical approach to constructing a knowledge graph for cybersecurity cybersecurity. *Engineering* 4(1), 53–60 (2018). [Online]. <https://doi.org/10.1016/j.eng.2018.01.004> <http://www.sciencedirect.com/science/article/pii/S2095809918301097>
- Xueqiu, Q., et al.: Automatic generation algorithm of penetration graph in penetration testing. In: In 2014 Ninth International Conference on P2P, Parallel, Grid, Cloud and Internet Computing, pp. 531–537 (2014)
- Zhang, S., et al.: Using attack graphs and intrusion evidences to extrapolate network security state. In: 2009 Fourth International Conference on Communications and Networking in China, pp. 1–6 (2009)
- Jung, S., et al.: Planning based on dynamic bayesian network algorithm using dynamic programming and variable elimination. In: 2009 4th International Conference on Autonomous Robots and Agents, pp. 109–114 (2009)
- Bringas, P.G.: Intensive use of bayesian belief networks for the unified, flexible and adaptable analysis of misuses and anomalies in network intrusion detection and prevention systems. In: 18th International Workshop on Database and Expert Systems Applications (DEXA 2007), pp. 365–371 (2007)
- Huangfu, Y., Zhou, L., Yang, C.: Routing the cyber-attack path with the bayesian network deducing approach. In: 2017 International Conference on Cyber-Enabled Distributed Computing and Knowledge Discovery (CyberC), pp. 5–10 (2017)
- Kschischang, F.R., Frey, B.J., Loeliger, H.: Factor graphs and the sum-product algorithm. *IEEE Trans. Inf. Theor.* 47(2), 498–519 (2001). <https://doi.org/10.1109/18.910572>
- Dechter, R.: Bucket elimination: a unifying framework for reasoning. *Artif. Intell.* 113(1), 41–85 (1999). [https://doi.org/10.1016/s0004-3702\(99\)00059-4](https://doi.org/10.1016/s0004-3702(99)00059-4)

36. Yedidia, J., Freeman, W., Weiss, Y.: Understanding Belief Propagation and its Generalizations, vol. 8, pp. 239–269 (2003)
37. Cowell, R., et al.: Probabilistic Networks and Expert Systems, vol. 43 (2001)
38. Sahu, A., et al.: Design and Evaluation of a Cyber-Physical Resilient Power System Testbed (2020). [Online]. <http://arxiv.org/abs/2011.13552>
39. Ankan, A.: pgmpy-python Library for Probabilistic Graphical Models. [Online]. <https://github.com/pgmpy/pgmpy>
40. Microsoft: Infer.net (2008). [Online]. <https://dotnet.github.io/infer/>
41. Nguyen, H., Palani, K., Nicol, D.: An Approach to Incorporating Uncertainty in Network Security Analysis, vol. 04, pp. 74–84 (2017)
42. Liu, Y., Man, H.: Network vulnerability assessment using bayesian networks. Proc. SPIE (2005)
43. Frigault, M., et al.: Measuring Network Security Using Dynamic Bayesian Network. Association for Computing Machinery (2008)
44. Wlazlo, P., et al.: Man-in-the-middle attacks and defence in a power system cyber-physical testbed. IET Cyber-Phys Syst Theory & Appl 6(3), 164–177 (2021). [Online]. <https://ietresearch.onlinelibrary.wiley.com/doi/abs/10.1049/cps2.12014>
45. Narimani, M.R., et al.: Generalized contingency analysis based on graph theory and line outage distribution factor. IEEE Syst. J. 16(1), 626–636 (2022). <https://doi.org/10.1109/jsyst.2021.3089548>
46. Sahu, A., et al.: Multi-source multi-domain data fusion for cyberattack detection in power systems. IEEE Access 9, 119118–119138 (2021). <https://doi.org/10.1109/access.2021.3106873>
47. Sahu, A., et al.: Cyber-physical dataset for mitm attacks in power systems. IEEE Dataport (2021)
48. Weaver, G.A., et al.: Cyber-physical models for power grid security analysis: 8-substation case. In: 2016 IEEE International Conference on Smart Grid Communications (SmartGridComm), pp. 140–146. IEEE (2016)
49. Cyber Physical Resilient Energy Systems: Test Cases. [Online]. <https://cypres.engr.tamu.edu/test-cases/>
50. Davis, K.R., et al.: Cyber-physical security assessment for electric power systems. In: IEEE-HKN: The Bridge (2016)
51. Davis, K.R., et al.: A cyber-physical modeling and assessment framework for power grid infrastructures. IEEE Trans. Smart Grid 6(5), 2464–2475 (2015). <https://doi.org/10.1109/tsg.2015.2424155>
52. Sahu, A.: CyPSA-Live Code (2022). [Online]. <https://github.com/Abhijeet1990/CYPSA-Live>
53. Mao, Z., et al.: Mitigating tcp congestion: a coordinated cyber and physical approach. In: 2021 North American Power Symposium (NAPS), pp. 1–6 (2021)
54. Illinois Center for a Smarter Electric Grid: WSCC 9-bus System. [Online]. <https://icseg.iti.illinois.edu/wsc-9-bus-system/>
55. Umunnakwe, A., et al.: Cyber-physical component ranking for risk sensitivity analysis using betweenness centrality. IET Cyber-Phys Syst Theory & Appl 6(3), 139–150 (2021). [Online]. <https://ietresearch.onlinelibrary.wiley.com/doi/abs/10.1049/cps2.12010>
56. Birchfield, A.B., et al.: Grid structural characteristics as validation criteria for synthetic networks. IEEE Trans. Power Syst. 32(4), 3258–3265 (2017). <https://doi.org/10.1109/tpwrs.2016.2616385>
57. Poolsappasit, N., Dewri, R., Ray, I.: Dynamic security risk management using bayesian attack graphs. IEEE Trans. Dependable Secure Comput. 9(1), 61–74 (2012). <https://doi.org/10.1109/tdsc.2011.34>
58. Girlich, F., Rossberg, M., Schaefer, G.: On the resistance of overlay networks against bandwidth exhaustion attacks. Telecommun. Syst. 60(4), 03–552 (2015). <https://doi.org/10.1007/s11235-015-9992-x>
59. Murphy, K.: How to Use the Bayes Net Toolbox (2007). [Online]. <http://bayesnet.github.io/bnt/docs/usage.html>

How to cite this article: Sahu, A., Davis, K.: Inferring adversarial behavior in cyber-physical power systems using a Bayesian attack graph approach. IET Cyber-Phys. Syst., Theory Appl. 8(2), 91–108 (2023). <https://doi.org/10.1049/cps2.12047>